


**ELEVATION**

- 2" COPPER SWEAT 90° BEND
- 2" COPPER PIPE, 4" LONG
- 2" BRASS MIP x SWEAT ADAPTER (TYP)
- \*2" FIP BALL VALVE W/LOCKWING
- 2" BRASS NIPPLE
- BLIND FLANGE x 2" FIP

4" THK. CONCRETE SLAB (520-C-2500) OVER 6" CAB/CMB COMPACTED TO 95%

TEE REQUIRED FOR BYPASS ONLY (TYP)

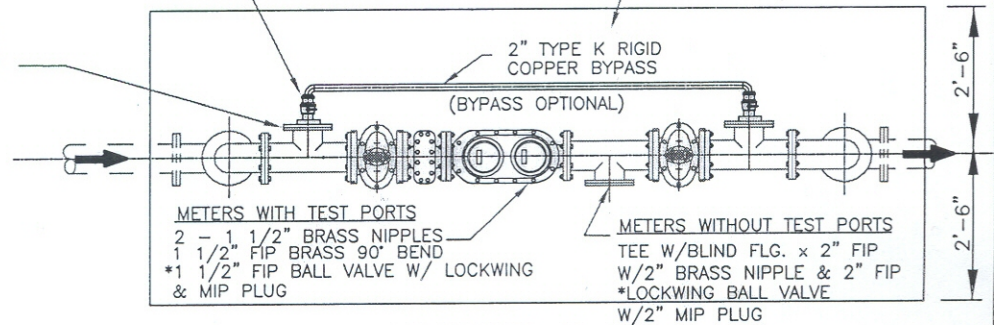

**PARTIAL PLAN**

**NOTE:**

- 1) ALL JOINTS FLANGED UNLESS OTHERWISE SHOWN. ALL FASTENERS SHALL BE 316 ST. STEEL.
- 2) IF BYPASS IS REQUIRED, IT SHALL BE 2" COPPER
- 3) GATE VALVES SHALL HAVE EVERDUR STEMS & NRS OPENING CCW.

- \*2" BALL VALVE } FORD B11-777WNL  
W/LOCKWING } JONES E-1900W
- \*1 1/2" BALL VALVE } FORD B11-666WNL  
W/LOCKWING } JONES E-1900W

ACCOMPANYING STD'S T700, T701, T712, T713 AND T723.

**CITY OF TORRANCE**

**TYPICAL 3" OR 4" ABOVE GROUND METER INSTALLATION**

STANDARD NO.

**T 717**

SHEET 1 OF 1

ROBERT J. BESTE  
PUBLIC WORKS DIRECTOR  
R.C.E. NO. 50737

*RB/BA*